


GROUND FLOOR PLAN
SCALE 1 : 50

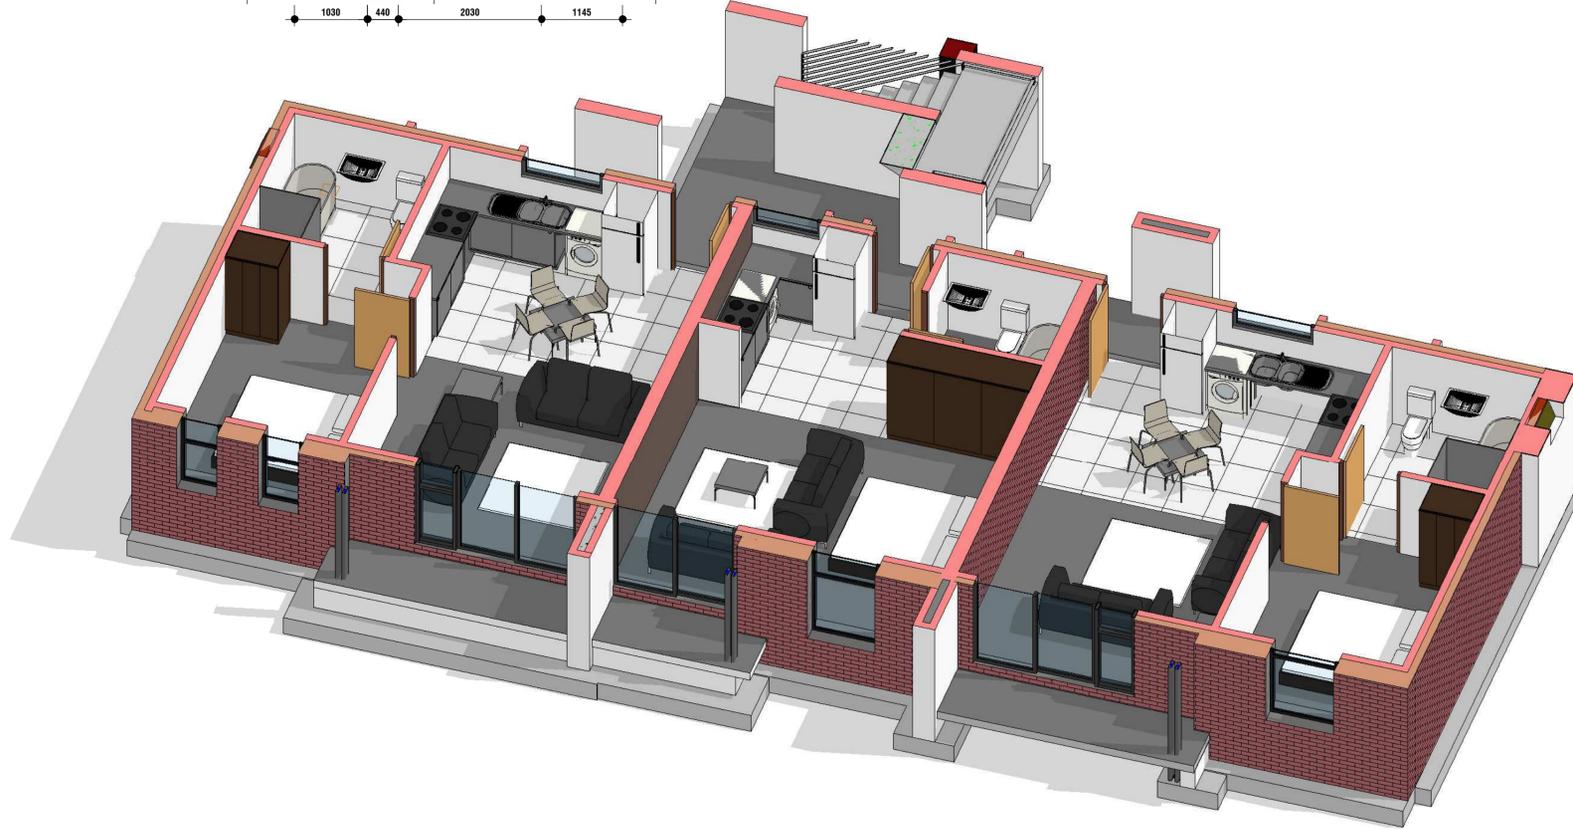

3D ILLUSTRATION
SCALE

GENERAL NOTES:

ALL WORK TO COMPLY WITH THE NATIONAL BUILDING REGULATION & BUILDING STANDARDS ACT SANS 1040, LOCAL COUNCIL REQUIREMENTS & ALL RELEVANT SPECIFICATIONS AND CODES.

ALL DOORS TO THE EXTERIOR THAT OPEN OUTWARD ARE TO HAVE A 10MM STEP UP ALONG THE LONGBOTTOM CENTERLINE OF THE DOOR LEAF. A BRUSH OR ALUMINUM TRIP IS TO BE INSTALLED TO THE THRESHOLD. ALL REINFORCED CONCRETE TO BE TO STRUCTURAL ENGINEERS CERTIFICATE & DETAIL TO BE SUBMITTED.

VERTICAL FINISHING TO ALL LEVEL CHANGES TO BE IN STRICT ACCORDANCE WITH ENGINEERS DETAIL AND SPECIALIST'S SPECIFICATION.

FINAL GROUND LEVELS TO BE DISCUSSED WITH ARCHITECT PRIOR TO ANY EXCAVATION ON SITE.

DIMENSIONS:
ALL DIMENSIONS OF ANY ROOM OR SPACE, HEIGHTS & AREAS ARE IN ACCORDANCE WITH REQUIREMENTS OF PART F OF SANS 1040. DIMENSIONS TO BE USED ON SITE. SITE AND WORKS TO BE KEPT CLEAR, NEAT, SECURE AND SAFE AT ALL TIMES.

PUBLIC SAFETY:
ALL CHANGES IN LEVELS, RAMPS, DRIVEWAYS & BALUSTRADES TO BE IN ACCORDANCE WITH PART D OF SANS 1040.
GLASS BALUSTRADES TO BE BAG TESTED TO INDUSTRY STANDARDS.

SITE OPERATIONS:
ALL SITE OPERATIONS WILL BE IN ACCORDANCE WITH PART F OF SANS 1040. ONLY DRAWINGS THAT REFLECT THE LATEST REVISIONS TO BE USED ON SITE. SITE AND WORKS TO BE KEPT CLEAR, NEAT, SECURE AND SAFE AT ALL TIMES.

ROOFS:
ROOF ASSEMBLY TO COMPLY WITH PART XA OF SANS 1040 & SANS 204. IN ACCORDANCE WITH CALCULATIONS PROVIDED. ALL INSULATION TO MEET TABSA STANDARDS & REGULATIONS. ROOF COVERINGS & WATERPROOFING SYSTEMS, SLOPE, GUTTERS & DOWNPIPES TO COMPLY WITH PART L OF SANS 1040 & TO SPECIALIST SPEC & DETAIL.

STARWAYS:
ALL STARWAYS TO COMPLY WITH ALL DIMENSIONAL, STRUCTURAL & SAFETY REQUIREMENTS OF PART M OF SANS 1040.

FENESTRATION & GLAZING:
REFER TO ATTACHED CALCULATIONS FOR REQUIREMENTS TO COMPLY WITH PART XA OF SANS 1040 & SANS 204.
GLAZING TO COMPLY WITH PART XA OF SANS 1040 & SANS 204. IN ACCORDANCE WITH CALCULATIONS PROVIDED. ALL ALUMINUM TO COMPLY WITH TABSA STANDARDS & REGULATIONS.
GLAZING TO COMPLY WITH INSTALLATION & ALL OTHER REQUIREMENTS OF PART N OF SANS 1040.

LIGHTING & VENTILATION:
ALL LIGHTING & VENTILATION REQUIREMENTS TO COMPLY WITH PART O & N OF SANS 1040.

STORMWATER:
STORMWATER CONTROL & DISPOSAL, GUTTERS & DOWNPIPES TO COMPLY WITH PART R OF SANS 1040.

FIRE INSTALLATION:
ALL TO COMPLY WITH PART W OF SANS 1040.

ENVIRONMENTAL, SUSTAINABILITY & ENERGY USAGE IN BUILDINGS: ALL TO COMPLY WITH PARTS X & XA OF SANS 1040 & SANS 204 WHERE APPLICABLE.
HOT WATER: WILL BE PROVIDED FROM ON-SITE HEAT PUMP. ALL PIPES WILL BE INSULATED TO A MIN R-VALUE OF 1 FOR PIPES GREATER THAN OR EQUAL TO 80MM & 1.5 FOR PIPES LESS THAN 80MM. TO BE INSTALLED TO MANUFACTURER'S SPECIFICATION.
LIGHTING & POWER: REFER TO ATTACHED CALCULATIONS FOR REQUIREMENTS TO COMPLY WITH PART XA OF SANS 1040 & SANS 204. ALL BULBS, DOWNLIGHTS, WALL LIGHTS & STRIP LIGHTS TO BE LED CONFORMING TO CALCULATIONS ATTACHED.

DRAINAGE:
SINGLE STACK SYSTEM COMPLYING WITH THE NATIONAL BUILDING REGULATIONS AND THE REQUIREMENTS OF THE LOCAL AUTHORITY AND COMPRISING THE FOLLOWING:
1. 1000 DISCHARGE STAKES OF APPROVED MATERIAL
2. 1000 DRAINS OF APPROVED MATERIAL
3. 1000 SOLE PIPES
4. 400 GREY WASTE PIPES
5. 1000 STACK VENTS
THE DISCHARGE STACK WILL CONTINUE UPWARDS TO FORM THE STACK VENT. THE RADIUS AT THE CENTRE LINE OF THE BEND AT THE FOOT OF THE DISCHARGE STACK SHALL NOT BE LESS THAN 200MM.
WHERE ANY WASTE BRANCH SHALL BE EITHER A P-TRAP WITH A WATERSEAL NOT LESS THAN 75MM OR A RE-SEALING TRAP OF THE TYPE:
WHERE ANY WASTE BRANCH AND ANY OPPOSED SOLE BRANCH ARE CONNECTED TO A DISCHARGE STACK THE CENTRE LINES AT THEIR INTERSECTIONS SHALL NOT BE LESS THAN 200MM APART.
THE FUTURE BRANCH OF ALL SANITARY FITTINGS IN THE SANITARY REGULATION SHALL BE SEPARATELY CONNECTED TO THE DISCHARGE STACK. THERE IS ONLY ONE GROUP FOR STORES CONNECTED TO ONE STACK.
ACCESS TO THE DRAINAGE INSTALLATION TO BE PROVIDED BY ADEQUATELY MARKED AND PROTECTED AND PERMANENTLY ACCESSIBLE ROOFTOP EYES AT:
1. ALL CHANGES OF DIRECTION
2. WITHIN 1.5M OF THE DRAIN CONNECTION TO THE SEWER
3. AT THE HIGHEST POINT OF THE DRAIN
4. AT 25M INTERVALS ALONG THE LINE OF THE DRAIN
PROVIDE INSPECTOR EYES AT ALL BENDS AND JUNCTIONS. DRAINS UNDER BUILDINGS TO BE PROTECTED FROM IMPOSITION OF ANY LOADS.

FLOORS:
SURFACE BEDS TO HAVE 40MM THICK EPS INSULATION & WATERPROOF MEMBRANE BELOW, WITH MIN R-VALUE OF 1.0 TO COMPLY WITH PART XA OF SANS 1040 & SANS 204.
RC BEAMS & SLAB TO ENG DETAIL & SPEC, WITH PENETRATION OR SIMILAR CRYSTALLINE INSULATION BELOW, WITH MIN R-VALUE OF 1.0 TO COMPLY WITH PART XA OF SANS 1040 & SANS 204.
FINISHED FLOOR LEVELS TO BE A MINIMUM OF 150MM ABOVE NATURAL GROUND LEVEL UNLESS OTHERWISE SHOWN.

WALLS:
WELL BURNT CLAY BRICKS OF MINIMUM 10MPa NOMINAL UNIT STRENGTH AND CLASS 2 MORTAR COMPLYING WITH THE NATIONAL BUILDING REGULATIONS.
ALL EXTERNAL WALLS TO BE MIN DOUBLE SKIN BRICK WALL TO COMPLY WITH PART XA OF SANS 1040 & SANS 204.
FIREWALLS TO UNDERSIDE OF ROOF COVERING.

STRUCTURAL ENGINEER:
STRUCTURAL ENGINEER TO BE RESPONSIBLE FOR ALL STRUCTURAL WORK INCLUDING BOUNDARY WALL, FOUNDATIONS, SOLE CONNECTIONS, SLABS, R.C. BEAMS, COLUMNS AND EXPANSION JOINTS.

The structural requirements of sub-regulation XA2 shall be satisfied when: 4.1.1 The population for which such building is designed is determined in accordance with Regulation A21; 4.1.2 The hot water demand is determined in accordance with table 4.1.1 of SANS 10221:2004; 4.1.3 The storage requirement is based on requirements of hot water temperature of 60 °C; 4.1.4 Solar water heating systems shall comply with SANS 1307, SANS 10106 and SANS 10254 based on the thermal performance determined in accordance with the requirements of SANS 6211-1 and SANS 6211-2; 4.1.5 All accepted hot water storage systems (SANS 10252) shall be clad with insulation with a minimum R-value in accordance with SANS 204; 4.1.6 Thermal insulation, if any, shall be installed in accordance with the manufacturer's instructions.

REVISIONS

No.	Description	Date



PROJECT:
HOLDING 119 RAVENSWOOD
AGRICULTURAL HOLDINGS

CLIENT: **Picture Perfect Trading 23 (Pty) Ltd**

DRAWING: **B.A.D BLOCK CONFIGURATION**

SCALES: 1 : 50

DRAWN BY: ET	CHECKED BY: GA
DATE DRAWN: 18/05/2017	DATE ISSUED: 2017/06/06
DWG NO: 600	REV:

SKETCH **COUNCIL**
CONSTRUCTION **TENDER**

2017/06/06 11:12:48 AM C:\Eugene work folder\Google Drive\1618 Boksburg\04 Drawings & Doc\04_3D_Current\BAD-Config Boksburg design-0D3-2017-06-05.rvt